




RISWAT® sealing system for water and gas tight sealing of conduit openings for ducting cables with various diameters

RISWAT® sealant is based on a single component silicone compound; the RISWAT® filler sleeves are made from a thermoplastic composition.

RISWAT® filler sleeves type 18/12 and 27/19 (blue colour) at about 1:2 ratio

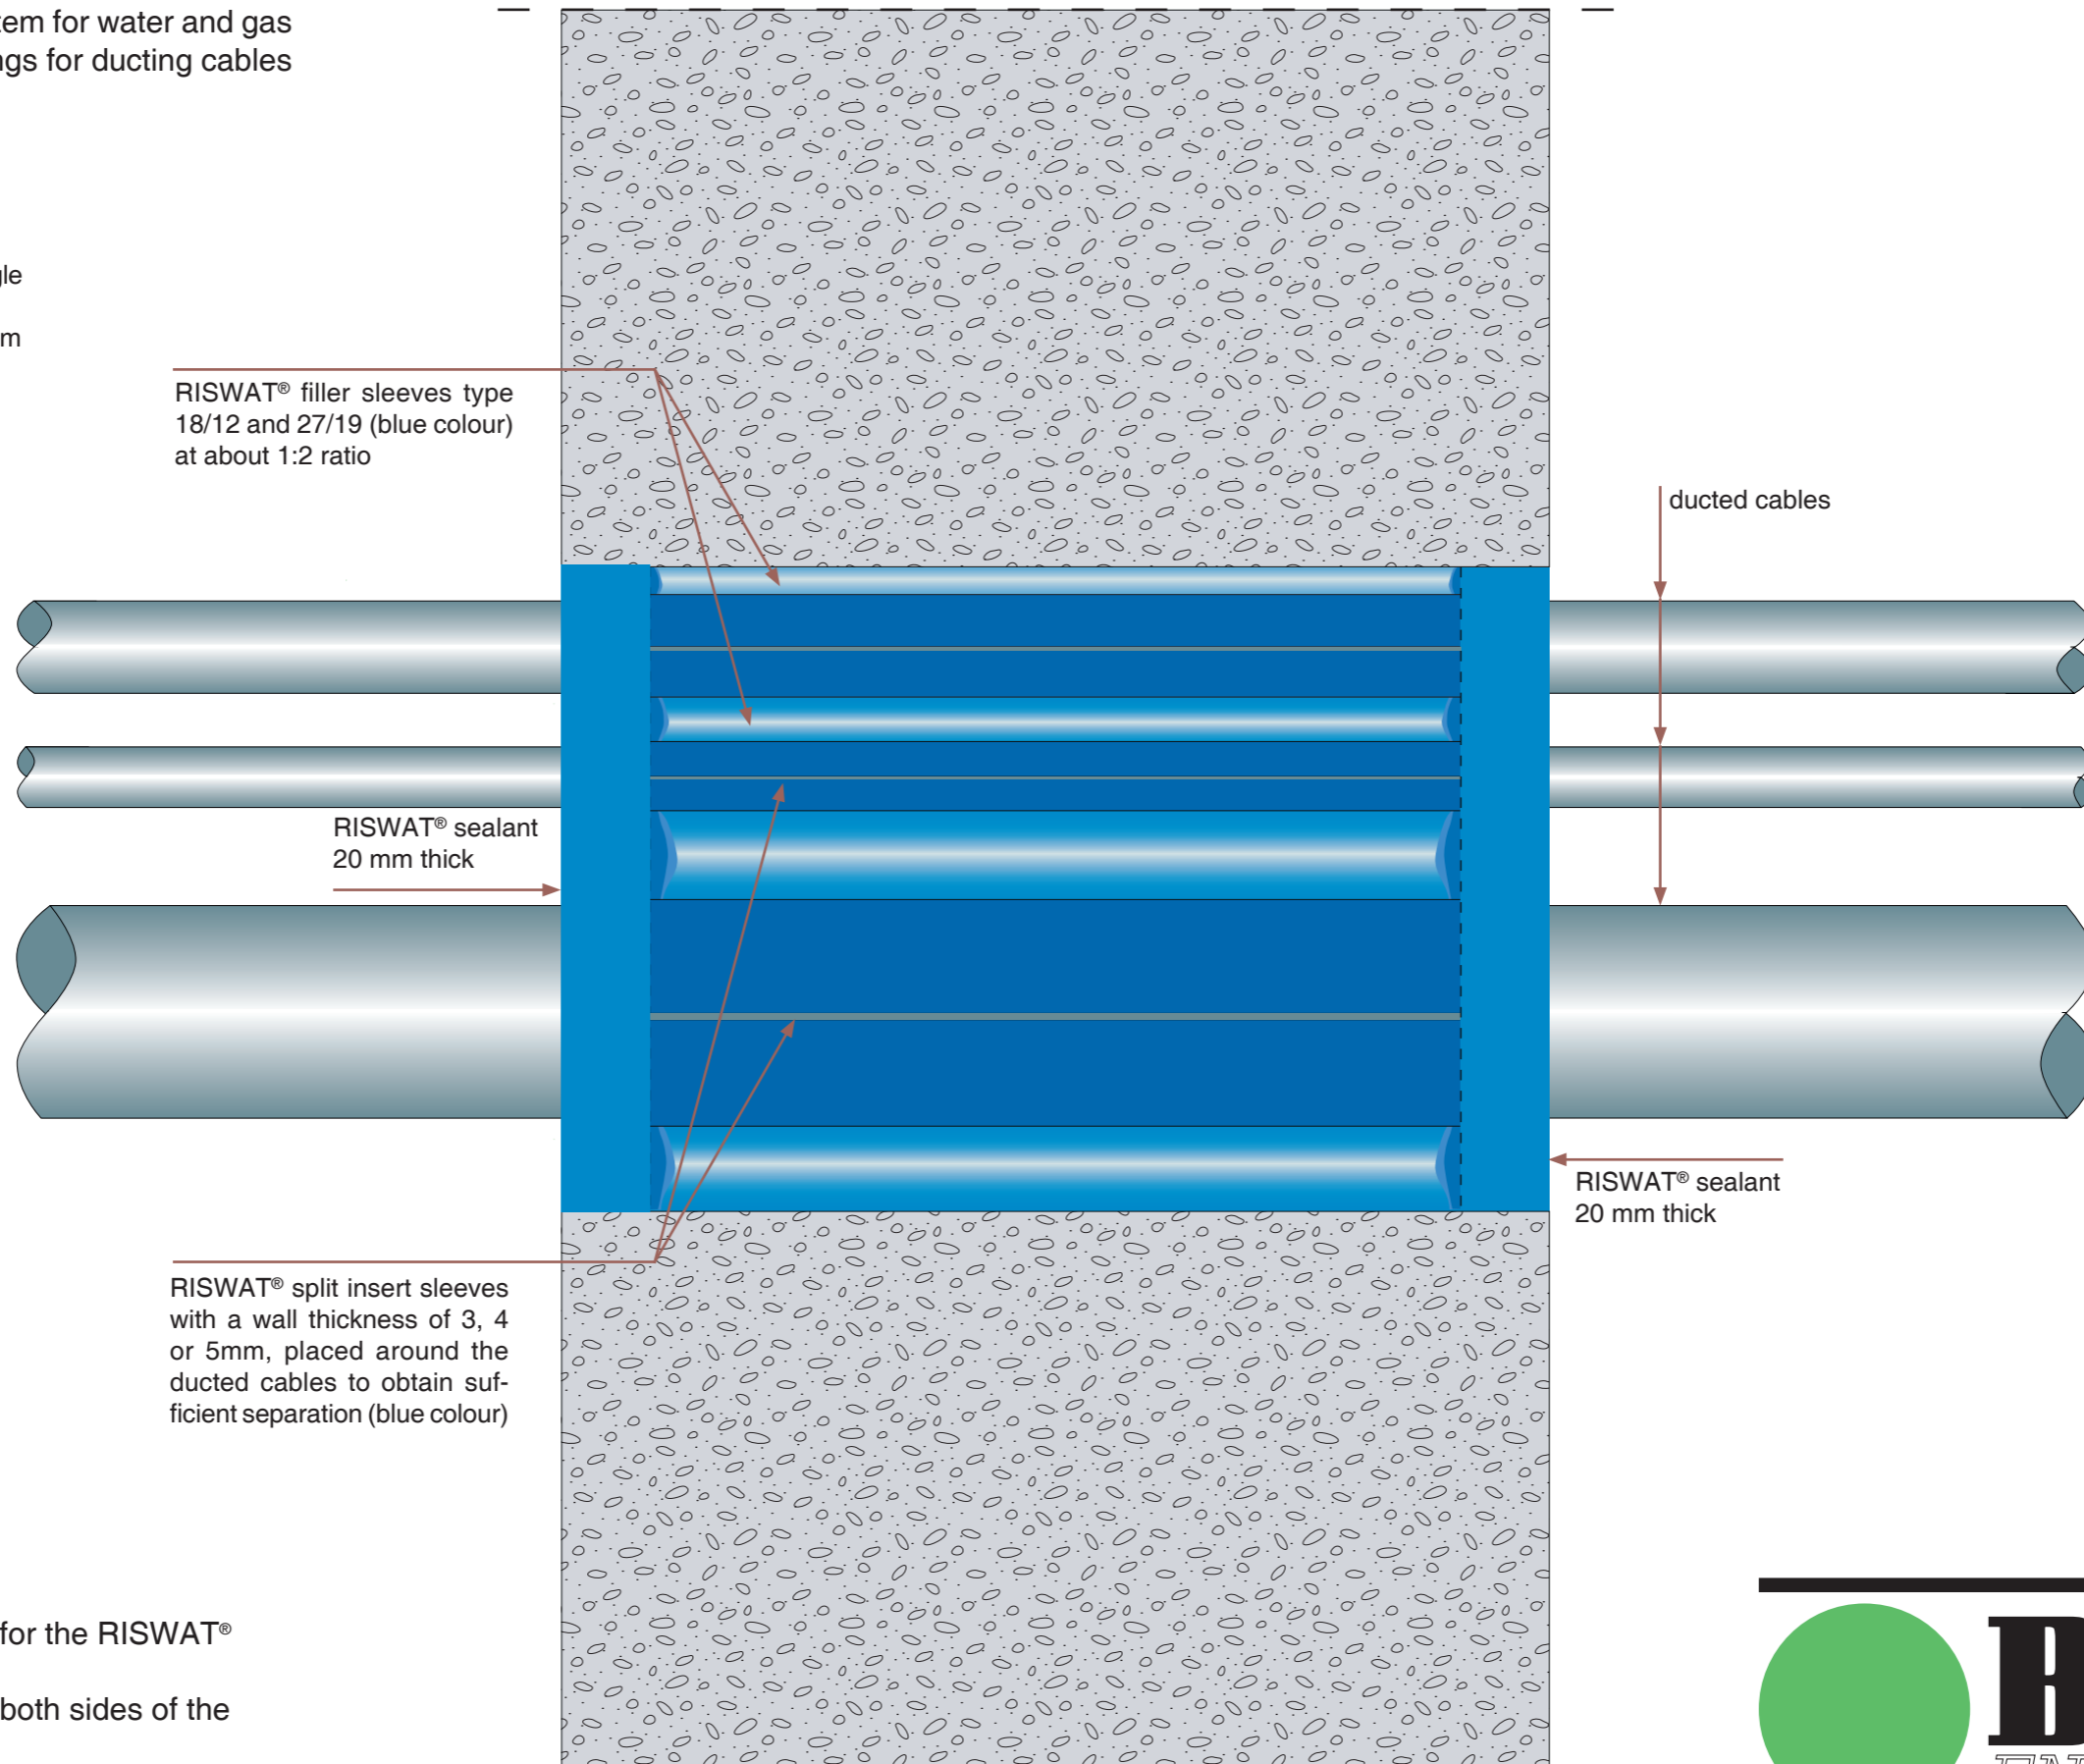

RISWAT® sealant 20 mm thick

ducted cables

RISWAT® sealant 20 mm thick

RISWAT® split insert sleeves with a wall thickness of 3, 4 or 5mm, placed around the ducted cables to obtain sufficient separation (blue colour)

Minimum wall/floor thickness for the RISWAT® sealing system is 100 mm. Sealant preferably applied at both sides of the conduit opening.



Website: <http://www.beele.com>