




RISWAT® sealing system for water and gas tight sealing of conduit openings for ducting single and multiple pipes

RISWAT® sealant is based on a single component silicone compound; the RISWAT® filler sleeves are made from a thermoplastic composition.

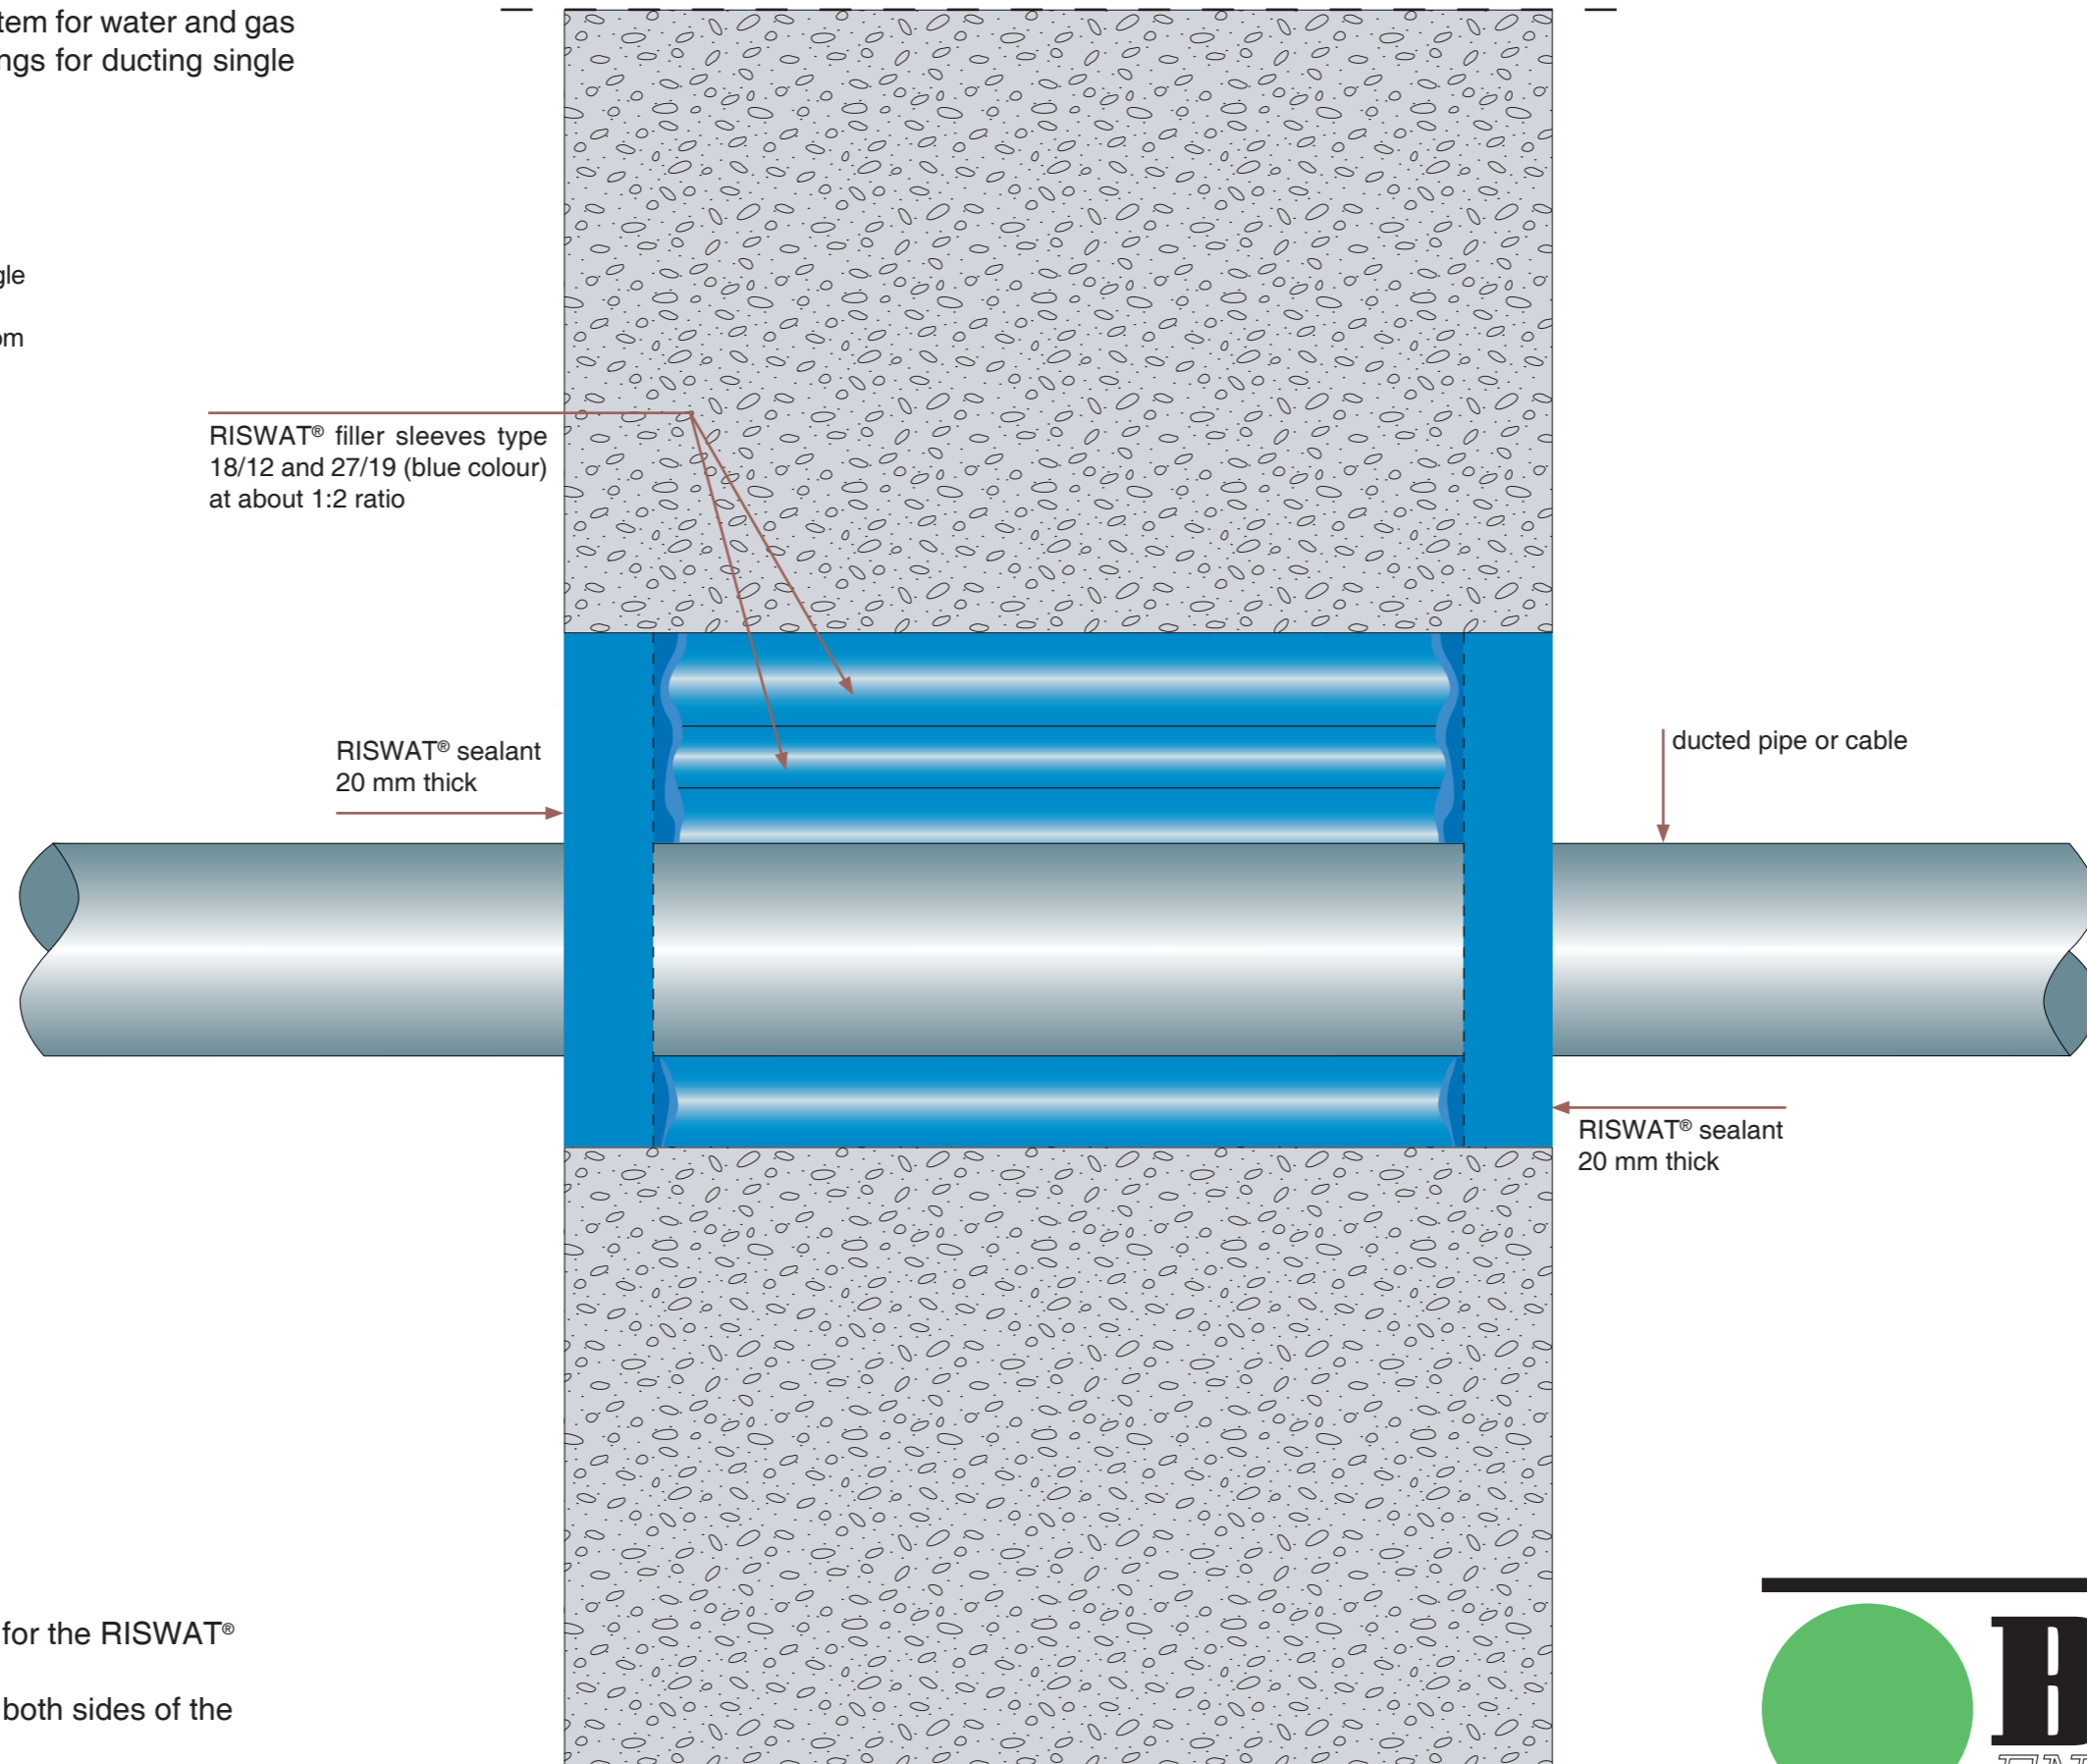

Minimum wall/floor thickness for the RISWAT® sealing system is 100 mm.  
Sealant preferably applied at both sides of the conduit opening.



Website: <http://www.beele.com>